CITY OF HOUSTON

Part III Flow Test Completion Status Report

HCC-SAN JACINTO BUILDING RENOVATION

Time: 10:00 AM Weather: CLOUDY Date: 3/22/2011

☒ Completed ☐ No Show ☐ Cancelled ☐ Re-scheduled On _____ AM

☐ Not Completed [Reason(s)] _____

Area Served ☐ Residential ☒ Commercial ☐ Industrial

No.	FIRE HYDRANTS		PRESSURES		FLOW @ RESIDUAL PRESSURE		
	LOCATION	MAKE	Static (psi)	Residual (psi)	Orifice Dia. (in)	Pitot PSI	Flow GPM
1	SAN JACINTO ST.	MUELLER	60	56	2.5		
2	SAN JACINTO ST.	MUELLER			2.5	50	1190
3					2.5		
4					2.5		

SKETCH

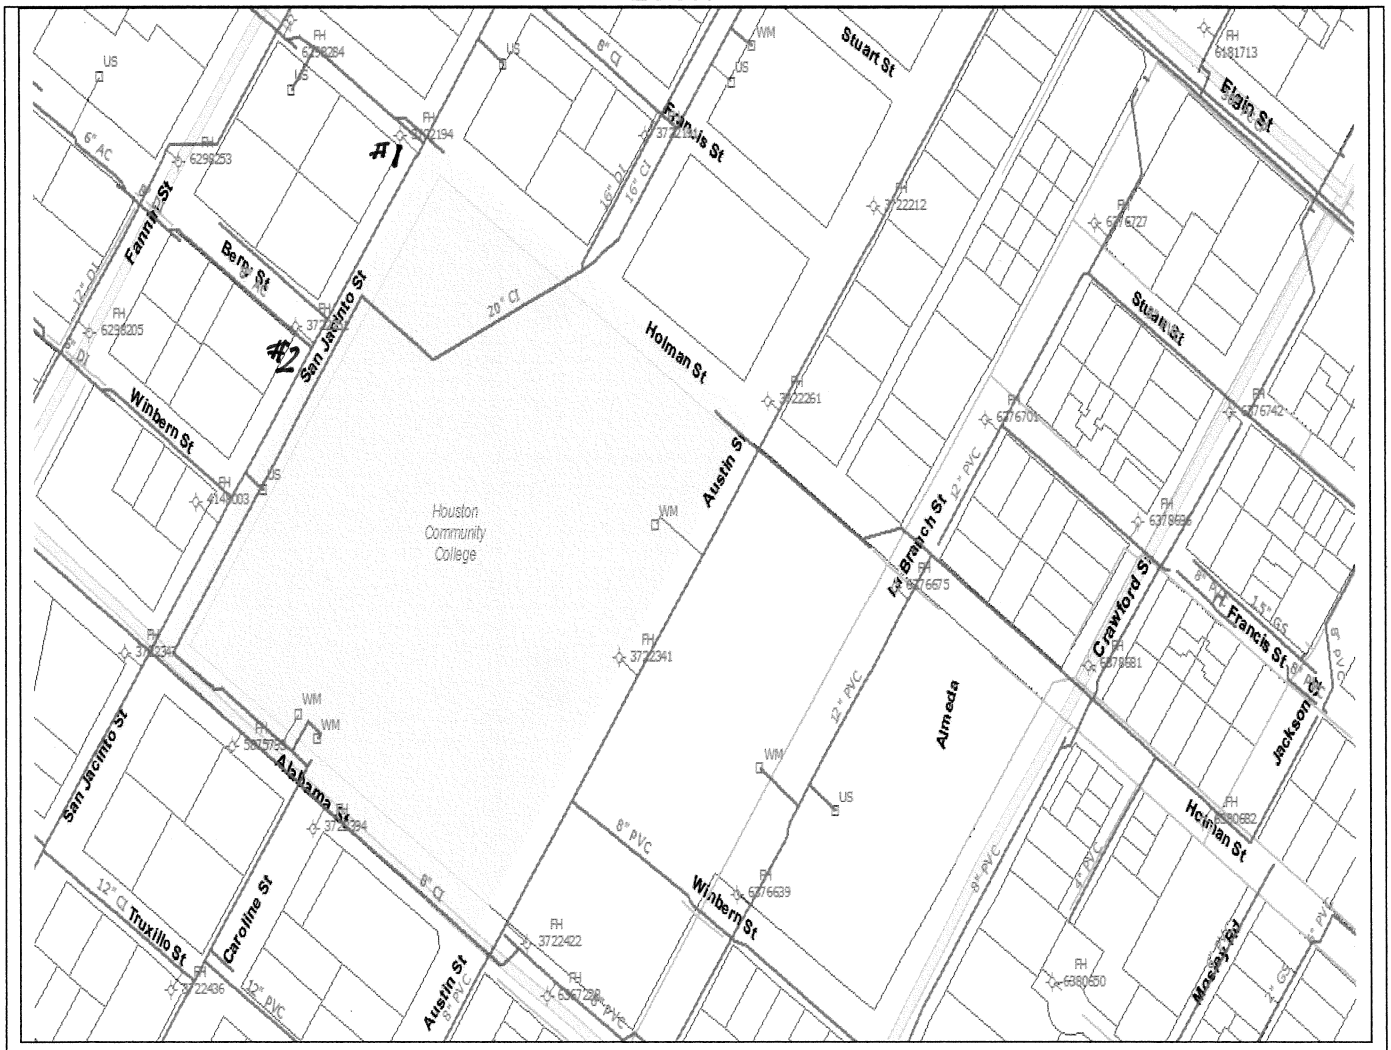

Key Map Page # 493T Address: 3410 HOLMAN ST

Signature(s): _____ (ALLIED FIRE PROTECTION, LP.) _____ (City of Houston Personnel).

CITY OF HOUSTON

Part III Flow Test Completion Status Report

HCC-SAN JACINTO BUILDING RENOVATION

Time: 10:00 AM Weather: CLOUDY Date: 3/22/2011

☒ Completed ☐ No Show ☐ Cancelled ☐ Re-scheduled On _____ AM

☐ Not Completed [Reason(s)] _____

Area Served ☐ Residential ☒ Commercial ☐ Industrial

No.	FIRE HYDRANTS		PRESSURES		FLOW @ RESIDUAL PRESSURE		
	LOCATION	MAKE	Static (psi)	Residual (psi)	Orifice Dia. (in)	Pitot PSI	Flow GPM
1	AUSTIN ST.	MUELLER	65	63	2.5		
2	AUSTIN ST.	MUELLER			2.5	56	1250
3					2.5		
4					2.5		

SKETCH

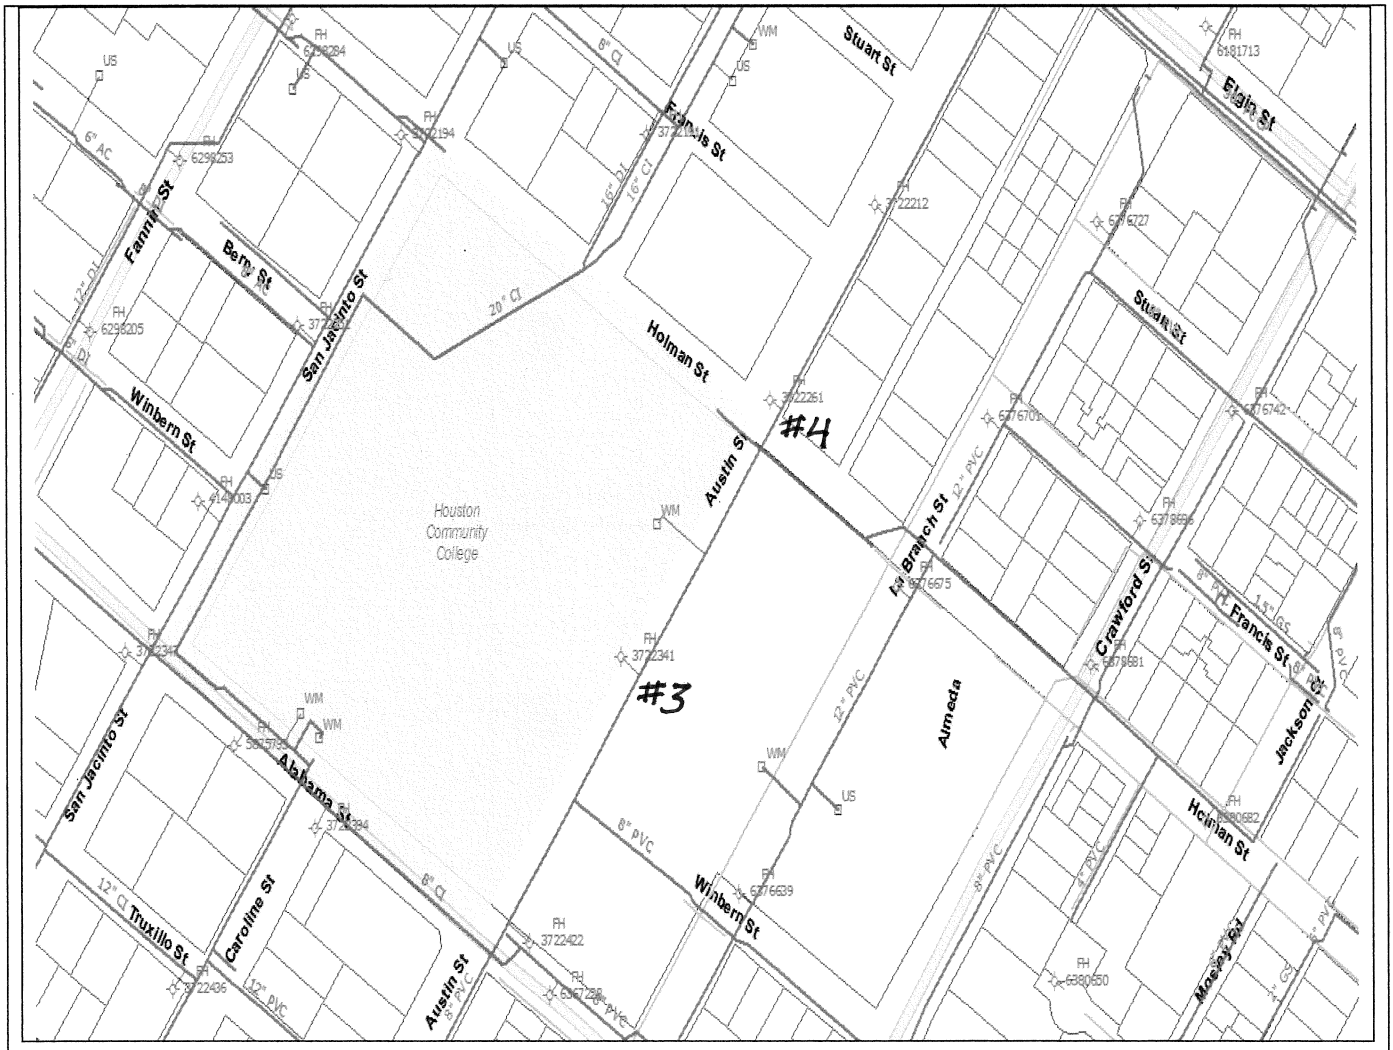

Key Map Page # 493T Address: 3410 HOLMAN ST

Signature(s): _____ (ALLIED FIRE PROTECTION, LP.) _____ (City of Houston Personnel).

CITY OF HOUSTON

Part III Flow Test Completion Status Report

HCC-SAN JACINTO BUILDING RENOVATION

Time: 10:00 AM Weather: CLOUDY Date: 3/22/2011

☒ Completed ☐ No Show ☐ Cancelled ☐ Re-scheduled On _____ AM

☐ Not Completed [Reason(s)] _____

Area Served ☐ Residential ☒ Commercial ☐ Industrial

No.	FIRE HYDRANTS		PRESSURES		FLOW @ RESIDUAL PRESSURE		
	LOCATION	MAKE	Static (psi)	Residual (psi)	Orifice Dia. (in)	Pitot PSI	Flow GPM
1	ALABAMA ST.	MUELLER	60	56	2.5		
2	ALABAMA ST.	MUELLER			2.5	40	1060
3					2.5		
4					2.5		

SKETCH

Key Map Page # 493T Address: 3410 HOLMAN ST

Signature(s): _____ (ALLIED FIRE PROTECTION, LP.) _____ (City of Houston Personnel).